

- GENERAL NOTES:**
- 1) VERIFY ALL DIMENSIONS WITH ARCHITECTURE PRIOR TO CONSTRUCTION.
 - 2) VERIFY ALL DROPS AND DROP LOCATIONS WITH ARCHITECTURE PRIOR TO CONSTRUCTION.
 - 3) SEE DETAIL 6/S2 FOR PLUMBING PENETRATIONS OF BEAMS.
 - 4) SEE DETAIL 16/S2 FOR ADDITIONAL REQUIRED REINFORCING AT BEAM INTERSECTIONS.

- FOUNDATION NOTES:**
- 1) MINIMUM GRADE BEAM SIZE: 12" X 24"
 - 2) MINIMUM 4" SLAB THICKNESS
 - 3) VERIFY ALL DIMENSIONS WITH ARCH.
 - 4) CONTACT ENG. FOR REDUCED BEAM DEPTH WHEN ROCK IS ENCOUNTERED.
 - 5) WHERE SOIL CONDITIONS OTHER THAN THOSE IN GEOTECHNICAL REPORT ARE ENCOUNTERED, CONTACT ENGINEER.

GEOTECHNICAL INFORMATION:
 ENGINEER: INTEG
 REPORT NUMBER: H061148
 REPORT DATE: 02/27/06

ALLOWABLE BEARING: 1050 PSF

	CENTER	EDGE
Em	4.5'	5.3'
Ym	1.18'	1.03'
DESIGN PI:	29	

BEAMS TO EXTEND MINIMUM:
 18" INTO FINISHED GRADE. DESIGN BASED UPON MIN. 18" SELECT FILL.

FOUNDATION PLAN

1/4"=1'-0"


15810 RIVER RAVEN CT.
 CYPRESS, TX 77429
 (832) 667-7615 (o)
 (832) 667-7614 (f)

TDI FOUNDATION ENGINEERING, LLC
 AUSTIN • HOUSTON

COMMERCIAL/RESIDENTIAL - CIVIL & STRUCTURAL ENGINEERING

AUBURN LAKES ESTATE
 SPRING, TEXAS 77389

CANNON CUSTOM HOMES

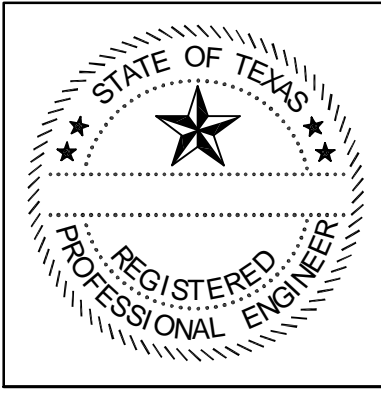

FOUNDATION PLAN

PROJECT #
130-115

DATE
03/15/06

SHEET
S1